

Sizes:

- | | |
|--|--|
| <input type="checkbox"/> 3' x 7' (.9 m x 2.1 m) | <input type="checkbox"/> 4' x 7' (1.2 m x 2.1 m) |
| <input type="checkbox"/> 4' x 8' (1.2 m x 2.4 m) | <input type="checkbox"/> 6' x 7' (1.6 m x 2.1 m) |
| <input type="checkbox"/> 8' x 8' (2.4 m x 2.4 m) | <input type="checkbox"/> Other _____ |

Finishes:



- Black Brown Tan White

Manufactured-On Date

Tools Required:

- Tape measure
- Knife or scissors

This product must be installed to allow the proper opening and closing of the door assembly with a minimal amount of force. The door assembly should be checked periodically to ensure proper operation.

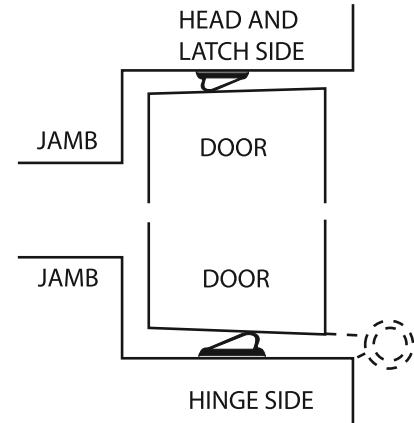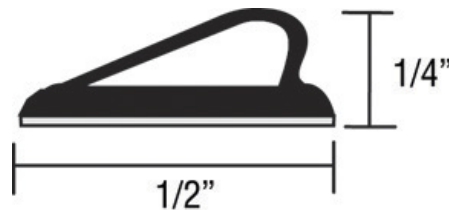

722 Intumescent Smoke and Fire Seal has been designed to provide an effective fire seal in the gap around a fire-rated door and/or at the meeting stile between a pair of fire-rated doors. This product is to be installed as illustrated above, around the perimeter of a door assembly. Care should be taken to install this product without damaging it in any way. The temperature of the frame or the door should be above 40° F. The frame should be thoroughly cleaned removing dust, oil, grease or dirt. When installing on a pair of doors the door should also be free of dust, oil, grease or dirt. The use of isopropyl alcohol is recommended. Cleansed surfaces should be allowed to dry thoroughly before application. For best results, apply when temperatures are between 50° F and 100° F (ideally between 65° F and 80° F). Certain paint products may cause poor adhesion. If necessary, lightly sand the painted surface and then thoroughly clean. Secure adhesion is crucial to the proper performance of this product.

1. Measure the frame at the top and both sides. Measure the meeting stile if applicable.
2. Cut the product to size using a knife or scissors.
3. Remove protective backing 1 foot at a time and apply in short sections using firm pressure.
4. Adhere seal to the exact location on door or frame where section is to be installed. Do not remove and relocate.
5. Inspect to ensure proper adhesion.
6. Do not install this product to impede the opening and closing of the door assembly. The door assembly must operate effectively.



POSITIVE PRESSURE TESTED GASKETING MATERIALS FOR FIRE DOORS
FOR APPLICATION TO CATEGORY B HOLLOW-METAL-TYPE FIRE DOORS RATED UP TO
3 HOURS, WOOD AND PLASTIC COVERED
COMPOSITE-TYPE FIRE DOORS RATED UP TO 1-1/2 HOURS
CATEGORY G, H & J
<73NN>